



Connection diagram of convectors in the variant with heating media valves.


Connection diagram for 12 V DC regulation of LICON OC convectors (PKOC, PKBOC, PKWOC, PKIOC, OLOC, OKIOC)

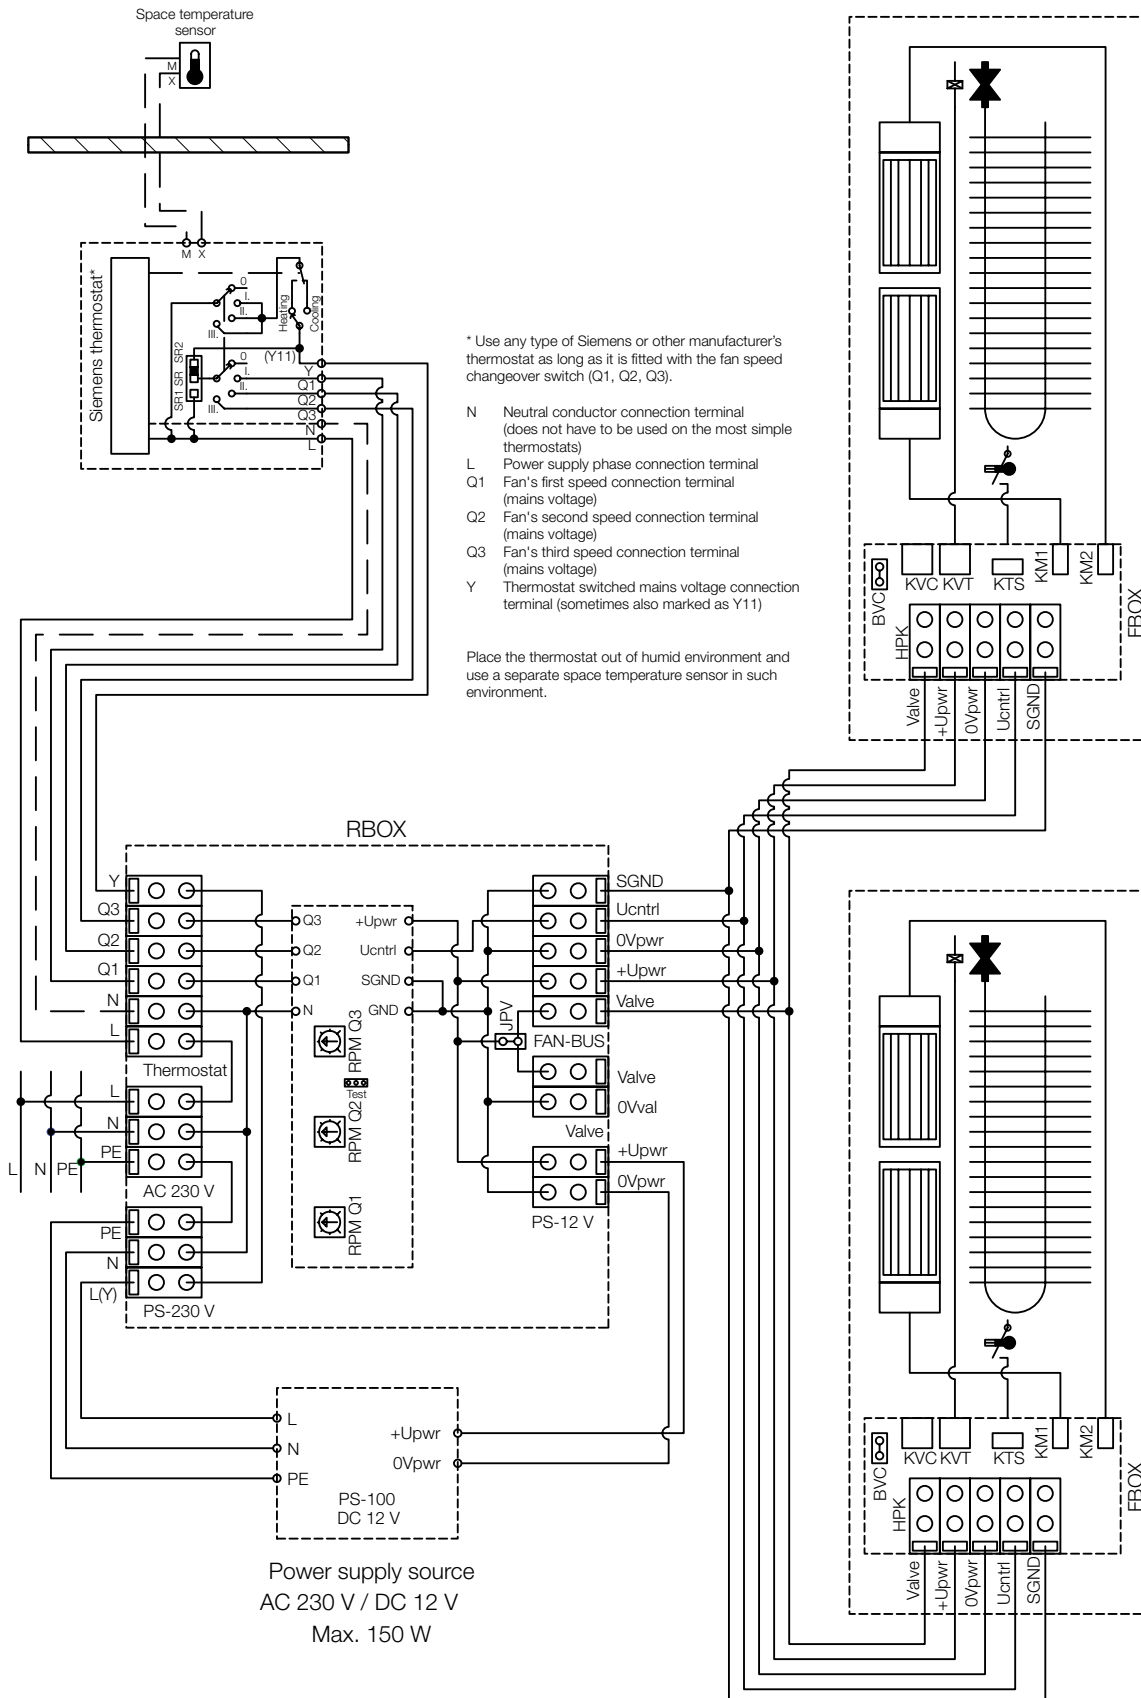


Connection diagram for 12 V and 24 V DC regulation of LICON OC convectors (PKOC, PKBOC, PKWOC, PKIOC, OLOC, OKIOC) – BMS control (Building Management System)

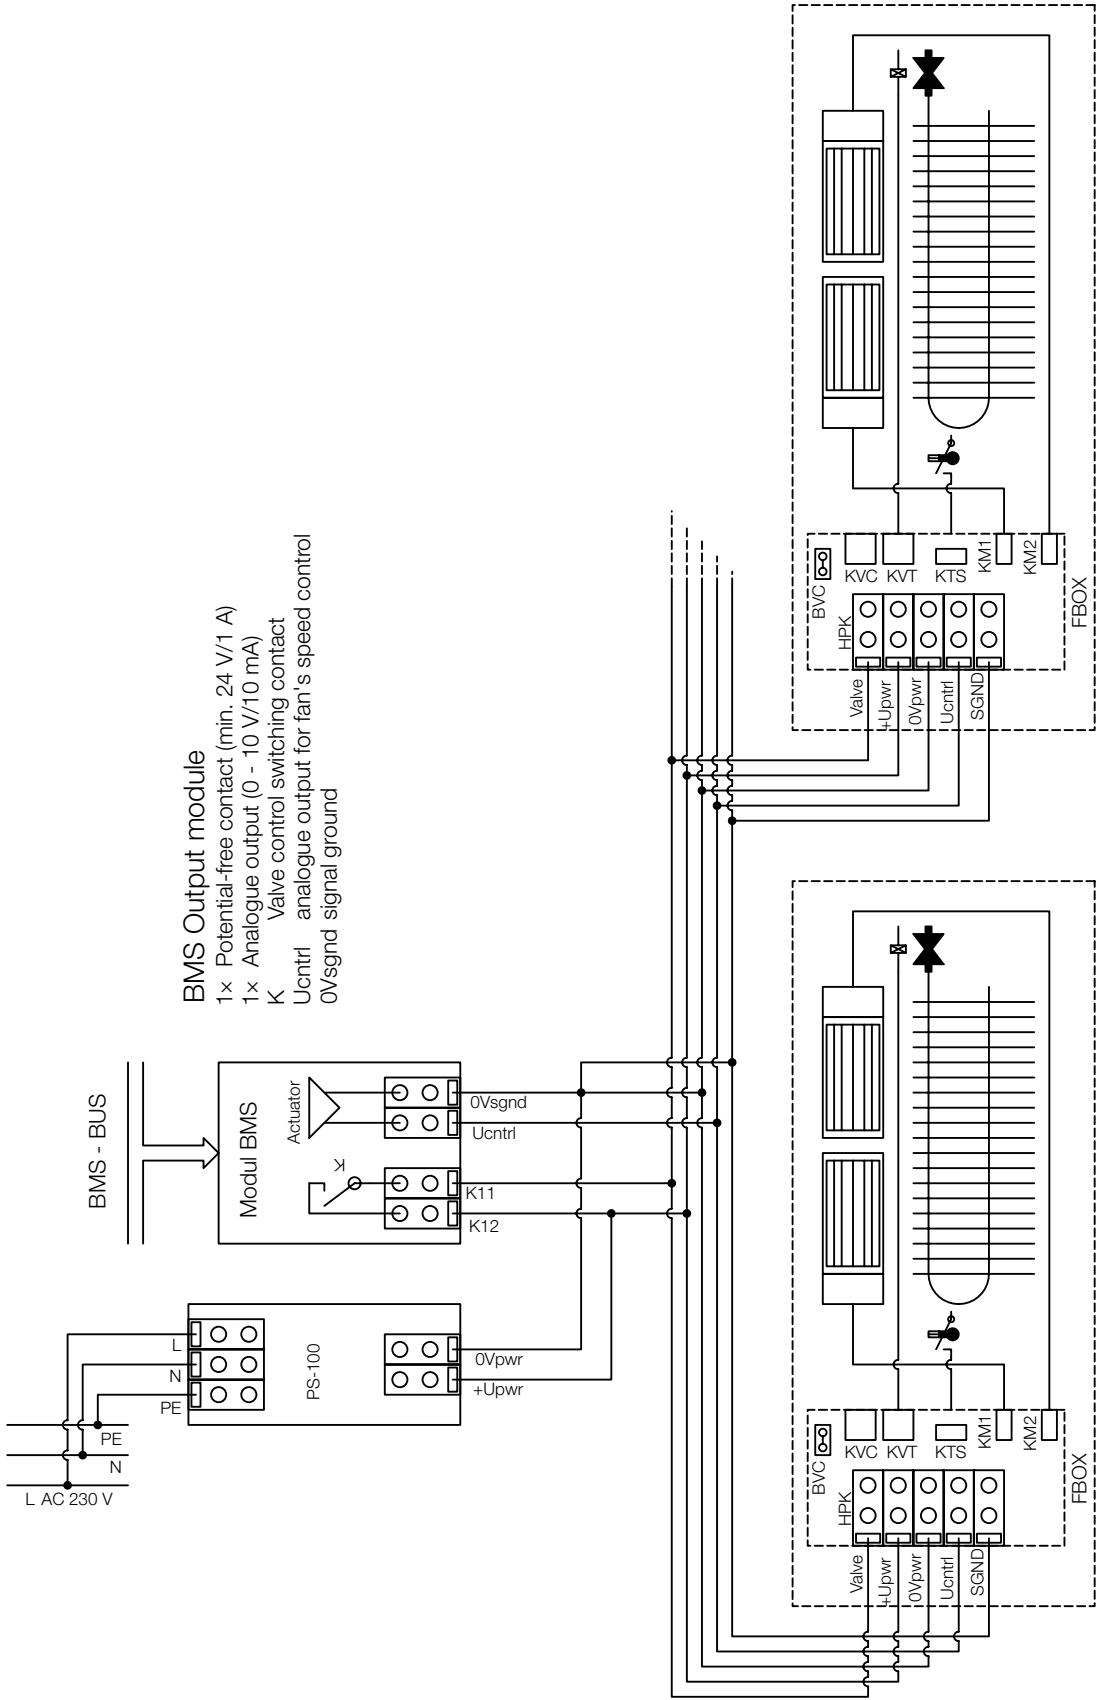

Connection diagram for **12 V DC regulation of LICON OC convectors**
(PKOC, PKBOC, PKWOC, PKIOC, OLOC, OKIOC)
with multiple DC voltage supply sources

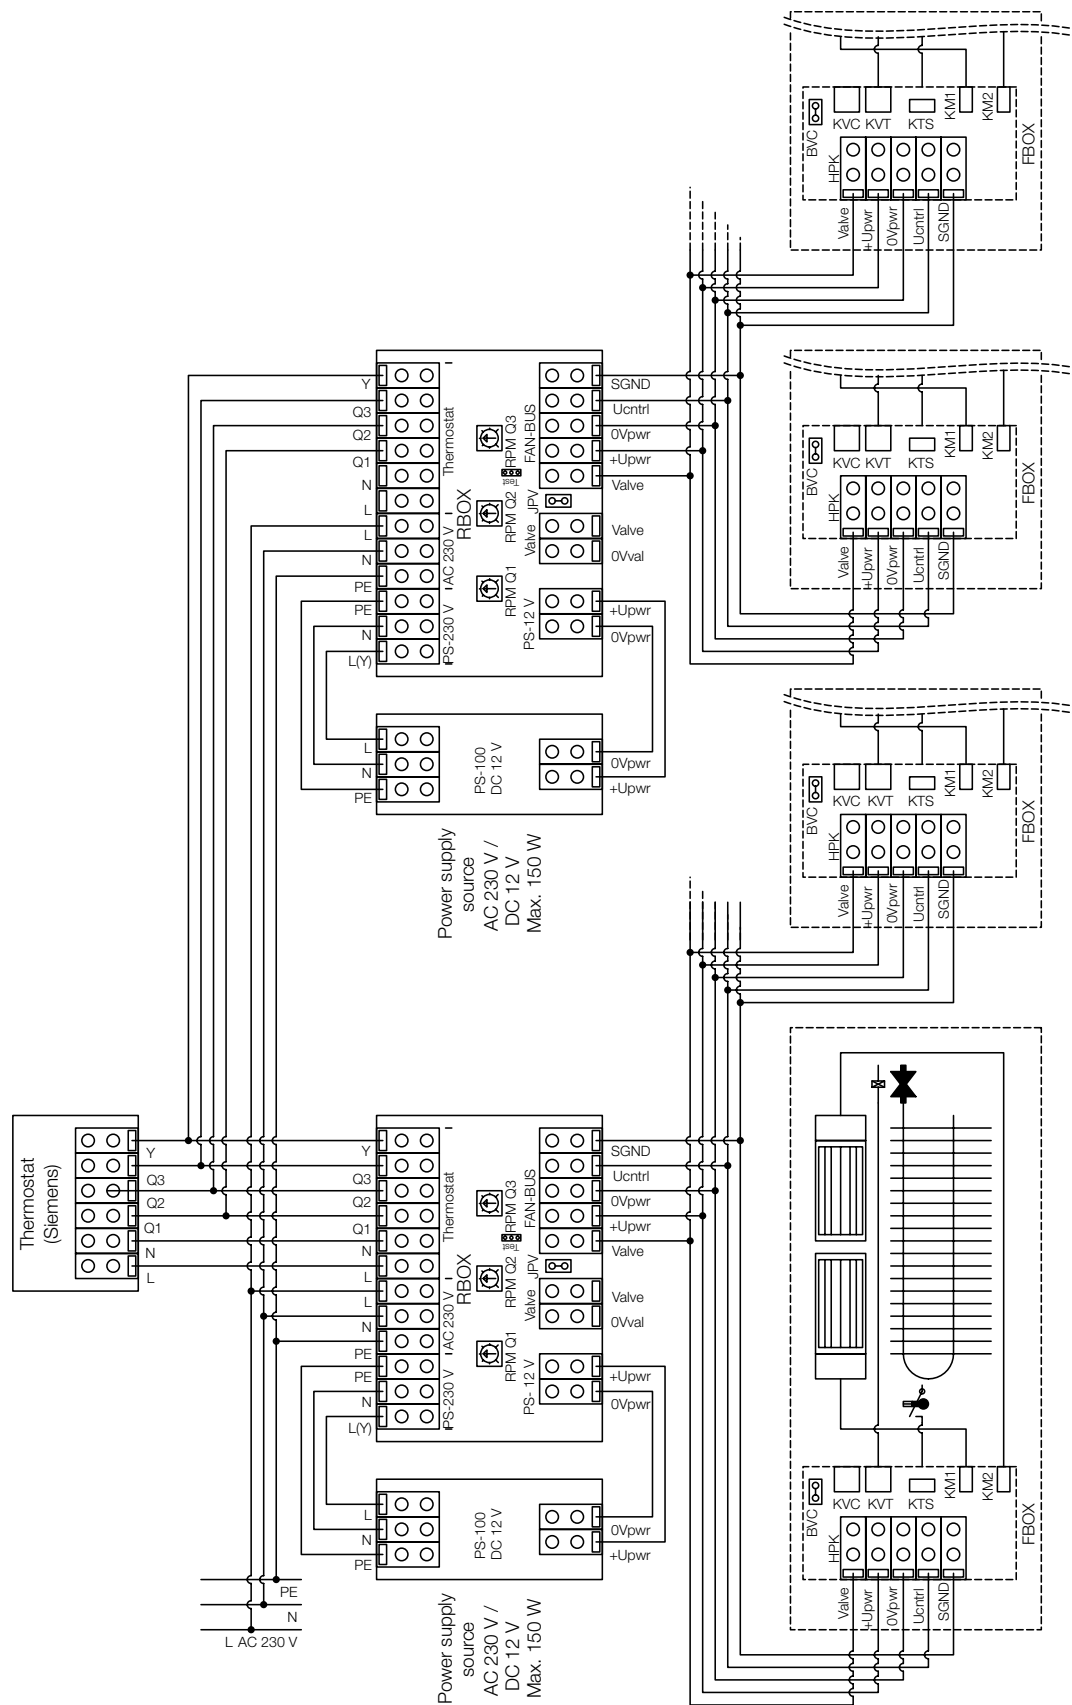

Connection diagram for 24 V DC regulation of LICON OC convectors (PKOC, PKBOC, PKIOC, OLOC, OKIOC), two-pipe system

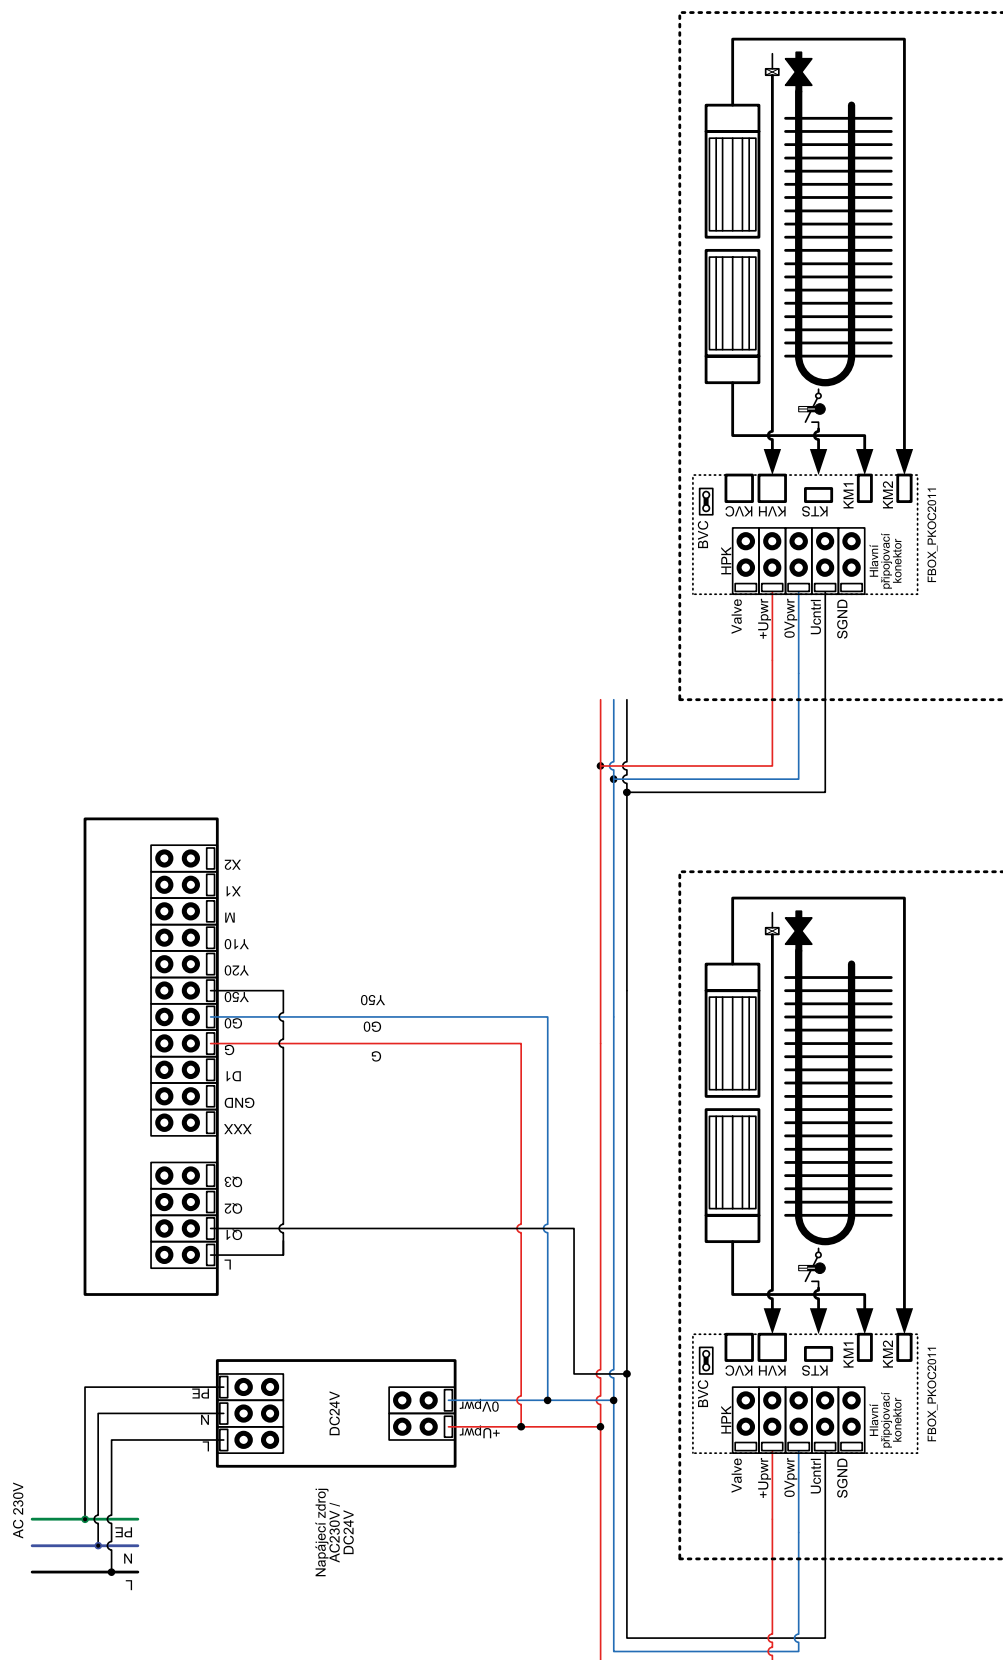

Note: Standard regulation is not equipped for independent control of valves (thermal drives) as for 4-tube systems (PKWOC).